

Susceptibility Report for System ID 0200324

System Details

Water System ID	0200324
System Name	COLONY COVE SUBDIVISION WATER SYSTEM
Address	17681 TELGE RD CYPRESS, TX 774297080
County	BRAZORIA
Telephone	7135745953
PWS Type	C
Total Production	0

Ground Water Sources

Source ID	Drill Date	Top Screened Interval (Ft.)	Bottom Screened Interval (Ft.)	Pumpage Rate (GPM)	Entry Point	Operational Status
G0200324B		430	450	45	001	Operational
G0200324A		330	350	48	001	Operational

Surface Water Sources

Source ID	Type	Surface Water Body	Entry Point	Operational Status
No surface water sources				

PWS System Susceptibility Summary: Contaminants with HIGH Susceptibility

The system is rated as having HIGH susceptibility to the contaminants listed below.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
DDE	----	Moderate	High	----	----	----	High
DIAZINON	----	Moderate	High	----	----	----	High
BORON	----	Moderate	High	----	----	----	High

INORGANICS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CYANIDE	----	Moderate	High	----	----	----	High
MANGANESE	----	Moderate	High	----	----	----	High
TDS	----	Moderate	High	----	----	----	High

INORGANICS MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
SPECIFIC CONDUCTANCE	----	Moderate	High	----	----	----	High

INORGANICS UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
SODIUM	----	Moderate	High	----	----	----	High

PHYSICAL

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
HARDNESS	----	Moderate	High	----	----	----	High

PHYSICAL PARAMETER

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
pH	----	Moderate	High	----	----	----	High

SOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2,4,5-T	----	Moderate	High	----	----	----	High
DIELDRIN	----	Moderate	High	----	----	----	High
ALDRIN	----	Moderate	High	----	----	----	High

SOC REGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2,4,5-TP	----	Moderate	High	----	----	----	High
ENDRIN	----	Moderate	High	----	----	----	High
GLYPHOSATE	----	Moderate	High	----	----	----	High
2,4-D	----	Moderate	High	----	----	----	High
ALACHLOR	----	Moderate	High	----	----	----	High
ATRAZINE	----	Moderate	High	----	----	----	High
BENZO(A)PYRENE	----	Moderate	High	----	----	----	High
CHLORDANE	----	Moderate	High	----	----	----	High
PENTACHLOROPHENOL	----	Moderate	High	----	----	----	High
SIMAZINE	----	Moderate	High	----	----	----	High

VOC - OTHER COMPOUNDS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
METHYL-T-BUTYL ETHER	----	Moderate	High	----	----	----	High

VOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,3-DICHLOROBENZENE	----	Moderate	High	----	----	----	High

VOC REGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,1,2-TRICHLOROETHANE	----	Moderate	High	----	----	----	High
CIS-1,2-DICHLOROETHYLENE	----	Moderate	High	----	----	----	High
DICHLOROMETHANE	----	Moderate	High	----	----	----	High
ETHYLBENZENE	----	Moderate	High	----	----	----	High
BENZENE	----	Moderate	High	----	----	----	High
TETRACHLOROETHYLENE	----	Moderate	High	----	----	----	High
TOLUENE	----	Moderate	High	----	----	----	High
TRANS-1,2-DICHLOROETHYLENE	----	Moderate	High	----	----	----	High
TRICHLOROETHYLENE	----	Moderate	High	----	----	----	High
VINYL CHLORIDE	----	Moderate	High	----	----	----	High

XYLENES (TOTAL)

Moderate

High

High

PWS System Susceptibility Summary: Contaminants with MODERATE Susceptibility

The system is rated as having MODERATE susceptibility to the contaminants listed below.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,2-DIPHENYLHYDRAZINE	----	Moderate	Low	----	----	----	Moderate
1,3-DICHLOROPROPENE	----	Moderate	Moderate	----	----	----	Moderate
CYANAZINE	----	Moderate	Moderate	----	----	----	Moderate
DCPA DI-ACID DEGRADATE	----	Moderate	Moderate	----	----	----	Moderate
DCPA MONO-ACID DEGRADATE	----	Moderate	Moderate	----	----	----	Moderate
DISULFOTON	----	Moderate	Moderate	----	----	----	Moderate
DIURON	----	Moderate	Moderate	----	----	----	Moderate
EPTC	----	Moderate	Moderate	----	----	----	Moderate
FONOFOS	----	Moderate	Moderate	----	----	----	Moderate
LINURON	----	Moderate	Moderate	----	----	----	Moderate
2,4,6-TRICHLOROPHENOL	----	Moderate	Low	----	----	----	Moderate
2,4-DICHLOROPHENOL	----	Moderate	Moderate	----	----	----	Moderate
2,4-DINITROPHENOL	----	Moderate	Moderate	----	----	----	Moderate
2,4-DINITROTOLUENE	----	Moderate	Low	----	----	----	Moderate
2,6-DINITROTOLUENE	----	Moderate	Low	----	----	----	Moderate
2-METHYLPHENOL	----	Moderate	Low	----	----	----	Moderate
ACETOCHLOR	----	Moderate	Moderate	----	----	----	Moderate
MOLINATE	----	Moderate	Moderate	----	----	----	Moderate
NITROBENZENE	----	Moderate	Low	----	----	----	Moderate
ORGANOTINS	----	Moderate	Low	----	----	----	Moderate
PERCHLORATE	----	Moderate	Low	----	----	----	Moderate
PROPAZINE	----	Moderate	Moderate	----	----	----	Moderate
RDX	----	Moderate	Low	----	----	----	Moderate
TERBACIL	----	Moderate	Moderate	----	----	----	Moderate
TERBUFOS	----	Moderate	Moderate	----	----	----	Moderate

INORGANICS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
COPPER	----	Moderate	----	----	----	----	Moderate
FLUORIDE	----	Moderate	----	----	----	----	Moderate
HYDROGEN SULFIDE	----	Moderate	Low	----	----	----	Moderate
IRON	----	Moderate	Low	----	----	----	Moderate
LEAD	----	Moderate	Low	----	----	----	Moderate
MERCURY	----	Moderate	Low	----	----	----	Moderate
ALUMINUM	----	Moderate	Low	----	----	----	Moderate
ANTIMONY	----	Moderate	----	----	----	----	Moderate
ARSENIC	----	Moderate	Low	----	----	----	Moderate
ASBESTOS	----	Moderate	----	----	----	----	Moderate
BARIUM	----	Moderate	Low	----	----	----	Moderate
BERYLLIUM	----	Moderate	----	----	----	----	Moderate
BROMIDE	----	Moderate	Low	----	----	----	Moderate
CADMIUM	----	Moderate	----	----	----	----	Moderate
CHLORIDE	----	Moderate	Moderate	----	----	----	Moderate
CHROMIUM	----	Moderate	----	----	----	----	Moderate
NICKEL	----	Moderate	Low	----	----	----	Moderate
NITRATE	----	Moderate	Low	----	----	----	Moderate
NITRATE+NITRITE	----	Moderate	Low	----	----	----	Moderate
NITRITE	----	Moderate	Low	----	----	----	Moderate
SELENIUM	----	Moderate	Low	----	----	----	Moderate

SILVER	----	Moderate	----	----	----	Moderate
SULFATE	----	Moderate	Low	----	----	Moderate
THALLIUM	----	Moderate	Low	----	----	Moderate
ZINC	----	Moderate	Moderate	----	----	Moderate

INORGANICS MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
MAGNESIUM	----	Moderate	Low	----	----	----	Moderate
ALKALINITY	----	Moderate	----	----	----	----	Moderate
BICARBONATE	----	Moderate	----	----	----	----	Moderate
CARBONATE	----	Moderate	----	----	----	----	Moderate

INORGANICS UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CALCIUM	----	Moderate	Low	----	----	----	Moderate

RADIOCHEM

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
GROSS ALPHA	----	Moderate	Low	----	----	----	Moderate
GROSS BETA	----	Moderate	Low	----	----	----	Moderate
RADIUM-226	----	Moderate	Low	----	----	----	Moderate
RADIUM-228	----	Moderate	Low	----	----	----	Moderate
STRONTIUM-90	----	Moderate	Low	----	----	----	Moderate
TRITIUM	----	Moderate	Low	----	----	----	Moderate

RADIOCHEM UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
RADON	----	Moderate	Low	----	----	----	Moderate
STRONTIUM-89	----	Moderate	Low	----	----	----	Moderate
URANIUM	----	Moderate	Low	----	----	----	Moderate

SOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
DIBENZ[A,H]ANTHRACENE	----	Moderate	----	----	----	----	Moderate
DICAMBA	----	Moderate	Moderate	----	----	----	Moderate
DIETHYL PHTHALATE	----	Moderate	Moderate	----	----	----	Moderate
DIMETHYL PHTHALATE	----	Moderate	Moderate	----	----	----	Moderate
DI-N-BUTYL PHTHALATE	----	Moderate	Low	----	----	----	Moderate
FLUORENE	----	Moderate	Low	----	----	----	Moderate
INDENO[1,2,3,CD]PYRENE	----	Moderate	----	----	----	----	Moderate
LAMBAST	----	Moderate	Moderate	----	----	----	Moderate
METHIOCARB	----	Moderate	Moderate	----	----	----	Moderate
METHOMYL	----	Moderate	Moderate	----	----	----	Moderate
METOLACHLOR	----	Moderate	Moderate	----	----	----	Moderate
3-HYDROXYCARBOFURAN	----	Moderate	Moderate	----	----	----	Moderate
ACENAPHTHENE	----	Moderate	Moderate	----	----	----	Moderate
ACENAPHTHYLENE	----	Moderate	Low	----	----	----	Moderate
ANTHRACENE	----	Moderate	Moderate	----	----	----	Moderate
BENTAZON	----	Moderate	Moderate	----	----	----	Moderate
BENZO[A]ANTHRACENE	----	Moderate	----	----	----	----	Moderate
BENZO[B]FLUORANTHENE	----	Moderate	Low	----	----	----	Moderate
BENZO[G,H,I]PERYLENE	----	Moderate	Low	----	----	----	Moderate

BENZO[K]FLUORANTHENE	----	Moderate	----	----	----	----	Moderate
BROMACIL	----	Moderate	Moderate	----	----	----	Moderate
BUTACHLOR	----	Moderate	Moderate	----	----	----	Moderate
BUTYL BENZYL PHTHALATE	----	Moderate	Low	----	----	----	Moderate
CARBARYL	----	Moderate	Moderate	----	----	----	Moderate
CHRYSENE	----	Moderate	Moderate	----	----	----	Moderate
METRIBUZIN	----	Moderate	Moderate	----	----	----	Moderate
PHENANTHRENE	----	Moderate	Low	----	----	----	Moderate
PROMETON	----	Moderate	Moderate	----	----	----	Moderate
PROPACHLOR	----	Moderate	Moderate	----	----	----	Moderate
PYRENE	----	Moderate	Low	----	----	----	Moderate
TRIFLURALIN	----	Moderate	Moderate	----	----	----	Moderate

SOC REGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2,3,7,8-TCDD	----	Moderate	----	----	----	----	Moderate
DALAPON	----	Moderate	Moderate	----	----	----	Moderate
DI-(2-ETHYLHEXYL)ADIPATE	----	Moderate	Moderate	----	----	----	Moderate
DI-(2-ETHYLHEXYL)PHTHALATE	----	Moderate	Moderate	----	----	----	Moderate
DIBROMOCHLOROPROPANE	----	Moderate	Moderate	----	----	----	Moderate
DINOSEB	----	Moderate	Moderate	----	----	----	Moderate
DIQUAT	----	Moderate	Moderate	----	----	----	Moderate
ENDOTHALL	----	Moderate	Moderate	----	----	----	Moderate
ETHYLENE DIBROMIDE	----	Moderate	----	----	----	----	Moderate
HEPTACHLOR	----	Moderate	Moderate	----	----	----	Moderate
HEPTACHLOR EPOXIDE	----	Moderate	Moderate	----	----	----	Moderate
HEXACHLOROBENZENE	----	Moderate	Moderate	----	----	----	Moderate
HEXACHLOROCYCLOPENTADIENE	----	Moderate	Moderate	----	----	----	Moderate
LINDANE	----	Moderate	Moderate	----	----	----	Moderate
METHOXYCHLOR	----	Moderate	Moderate	----	----	----	Moderate
ALDICARB	----	Moderate	Moderate	----	----	----	Moderate
ALDICARB SULFONE	----	Moderate	Moderate	----	----	----	Moderate
ALDICARB SULFOXIDE	----	Moderate	Moderate	----	----	----	Moderate
CARBOFURAN	----	Moderate	Moderate	----	----	----	Moderate
CHLORDANE (ALPHA-CHLORDANE)	----	Moderate	Moderate	----	----	----	Moderate
CHLORDANE (GAMMA-CHLORDANE)	----	Moderate	Moderate	----	----	----	Moderate
CHLORDANE (TRANS-NONACHLOR)	----	Moderate	Moderate	----	----	----	Moderate
OXAMYL	----	Moderate	Moderate	----	----	----	Moderate
PCBs	----	Moderate	Low	----	----	----	Moderate
PICLORAM	----	Moderate	Moderate	----	----	----	Moderate
TOXAPHENE	----	Moderate	Moderate	----	----	----	Moderate

THM

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
DIBROMOCHLOROMETHANE	----	Moderate	----	----	----	----	Moderate
BROMOCHLOROMETHANE	----	Moderate	----	----	----	----	Moderate
BROMODICHLOROMETHANE	----	Moderate	----	----	----	----	Moderate
BROMOFORM	----	Moderate	Low	----	----	----	Moderate
BROMOMETHANE	----	Moderate	Moderate	----	----	----	Moderate
CHLOROFORM	----	Moderate	Moderate	----	----	----	Moderate

VOC - OTHER COMPOUNDS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
------------------	----------------------	------------------------------	-----------------	--------------	------------------------	------------------------	---------

ETHYL METHACRYLATE	----	Moderate	Low	----	----	----	Moderate
METHYL IODIDE (Iodomethane)	----	Moderate	Moderate	----	----	----	Moderate
METHYL ETHYL KETONE	----	Moderate	Low	----	----	----	Moderate
METHYL METHACRYLATE	----	Moderate	Low	----	----	----	Moderate
2-HEXANONE	----	Moderate	Low	----	----	----	Moderate
4-METHYL-2-PENTANONE (MIBK)	----	Moderate	Low	----	----	----	Moderate
ACETONE	----	Moderate	Low	----	----	----	Moderate
ACRYLONITRILE	----	Moderate	Low	----	----	----	Moderate
CARBON DISULFIDE	----	Moderate	Moderate	----	----	----	Moderate
TETRAHYDROFURAN	----	Moderate	Low	----	----	----	Moderate
VINYL ACETATE	----	Moderate	Low	----	----	----	Moderate

VOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,1,1,2-TETRACHLOROETHANE	----	Moderate	Low	----	----	----	Moderate
1,1,2,2-TETRACHLOROETHANE	----	Moderate	Moderate	----	----	----	Moderate
1,1-DICHLOROETHANE	----	Moderate	Low	----	----	----	Moderate
1,1-DICHLOROPROPENE	----	Moderate	Low	----	----	----	Moderate
1,2,3-TRICHLOROBENZENE	----	Moderate	Low	----	----	----	Moderate
1,2,3-TRICHLOROPROPANE	----	Moderate	Low	----	----	----	Moderate
1,2,4-TRIMETHYLBENZENE	----	Moderate	Low	----	----	----	Moderate
1,3,5-TRIMETHYLBENZENE	----	Moderate	Low	----	----	----	Moderate
1,3-DICHLOROPROPANE	----	Moderate	Moderate	----	----	----	Moderate
2,2-DICHLOROPROPANE	----	Moderate	----	----	----	----	Moderate
CIS-1,3-DICHLOROPROPENE	----	Moderate	Moderate	----	----	----	Moderate
DIBROMOMETHANE	----	Moderate	Low	----	----	----	Moderate
DICHLORODIFLUOROMETHANE	----	Moderate	Moderate	----	----	----	Moderate
HEXACHLOROBUTADIENE	----	Moderate	Low	----	----	----	Moderate
ISOPROPYLBENZENE	----	Moderate	Low	----	----	----	Moderate
M + P XYLENE	----	Moderate	Low	----	----	----	Moderate
2-CHLOROTOLUENE	----	Moderate	Moderate	----	----	----	Moderate
4-CHLOROTOLUENE	----	Moderate	Low	----	----	----	Moderate
4-ISOPROPYLTOLUENE	----	Moderate	Low	----	----	----	Moderate
BROMOBENZENE	----	Moderate	----	----	----	----	Moderate
CHLOROETHANE	----	Moderate	Moderate	----	----	----	Moderate
CHLOROMETHANE	----	Moderate	Low	----	----	----	Moderate
NAPHTHALENE	----	Moderate	Low	----	----	----	Moderate
N-BUTYLBENZENE	----	Moderate	----	----	----	----	Moderate
N-PROPYLBENZENE	----	Moderate	----	----	----	----	Moderate
S-BUTYLBENZENE	----	Moderate	Low	----	----	----	Moderate
T-BUTYLBENZENE	----	Moderate	----	----	----	----	Moderate
TRANS-1,3-DICHLOROPROPENE	----	Moderate	Moderate	----	----	----	Moderate
TRICHLOROFLUOROMETHANE	----	Moderate	Moderate	----	----	----	Moderate

VOC REGULATED


Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
1,1,1-TRICHLOROETHANE	----	Moderate	Moderate	----	----	----	Moderate
1,1-DICHLOROETHYLENE	----	Moderate	Moderate	----	----	----	Moderate
1,2,4-TRICHLOROBENZENE	----	Moderate	Moderate	----	----	----	Moderate
1,2-DICHLOROETHANE	----	Moderate	Moderate	----	----	----	Moderate
1,2-DICHLOROPROPANE	----	Moderate	Moderate	----	----	----	Moderate
CARBON TETRACHLORIDE	----	Moderate	Moderate	----	----	----	Moderate
CHLOROBENZENE (MONOCHLOROBENZENE)	----	Moderate	Moderate	----	----	----	Moderate

MONOCHLOROBENZENE (CHLOROBENZENE)	----	Moderate	Low	----	----	----	Moderate
M-XYLENE	----	Moderate	Low	----	----	----	Moderate
ORTHO-1,2-DICHLOROBENZENE	----	Moderate	Moderate	----	----	----	Moderate
O-XYLENE	----	Moderate	Low	----	----	----	Moderate
PARA-1,4-DICHLOROBENZENE	----	Moderate	Moderate	----	----	----	Moderate
P-XYLENE	----	Moderate	Low	----	----	----	Moderate
STYRENE	----	Moderate	Low	----	----	----	Moderate

Other

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CRYPTOSPORIDIUM PARVUM	----	Moderate	Moderate	----	----	----	Moderate
ESCHERICHIA COLI	----	Moderate	Moderate	----	----	----	Moderate
FECAL VIRUSES	----	Moderate	Moderate	----	----	----	Moderate
GIARDIA LAMBLIA	----	Moderate	Moderate	----	----	----	Moderate
AROCLOR (PCB)	----	Moderate	Moderate	----	----	----	Moderate
P-ALKALINITY	----	Moderate	----	----	----	----	Moderate
TOTAL ALPHA EMITTING RADIUM	----	Moderate	Low	----	----	----	Moderate
TOTAL COLIFORM	----	Moderate	Moderate	----	----	----	Moderate
TOTAL TRIHALOMETHANE	----	Moderate	----	----	----	----	Moderate
TRIAZINES	----	Moderate	Moderate	----	----	----	Moderate

Source Details: G0200324B

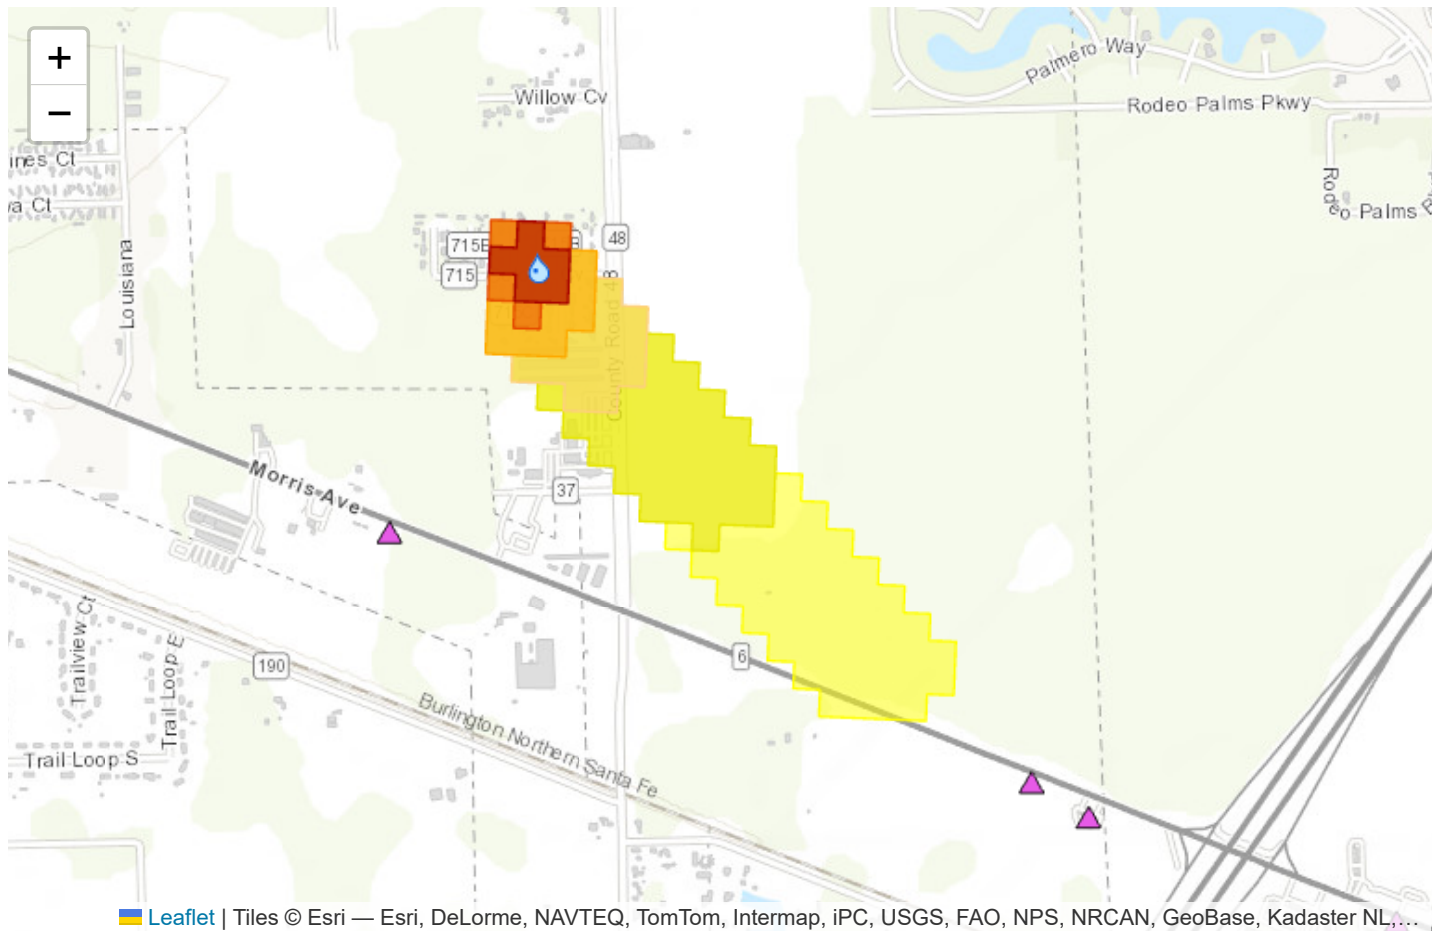


Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Source Details: G0200324A

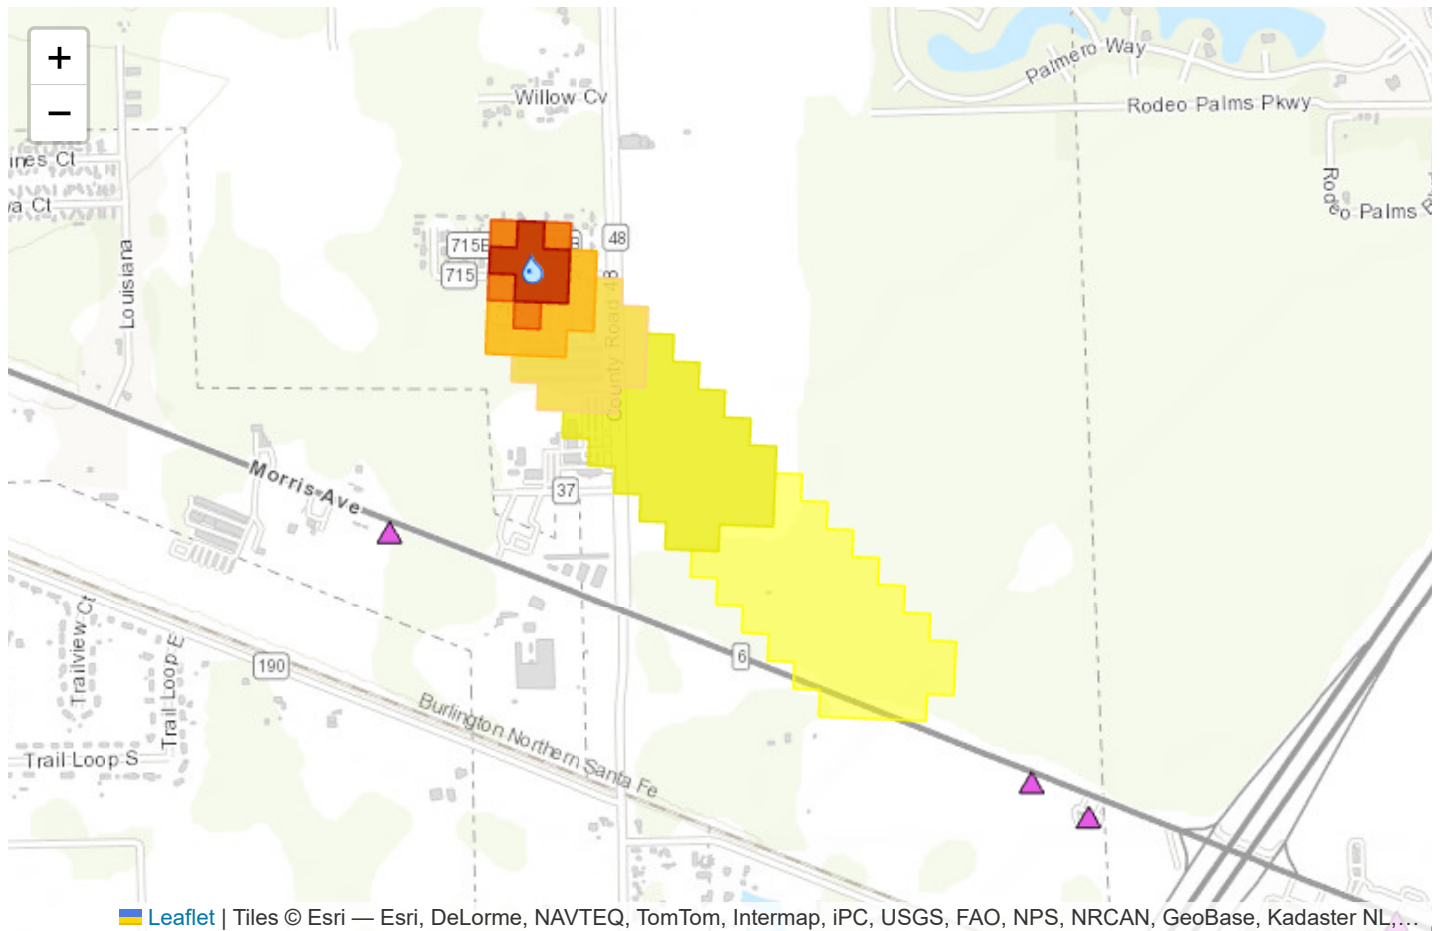

Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Contaminant List

List of regulated and unregulated assessed contaminants grouped by contaminant class. TCEQ Chapter 290 Subchapter F rules are cited for each drinking water standard (secondary drinking water standards are italicized). The TCEQ threshold limit is the concentration used within the contaminant occurrence component to determine if a detection of the chemical was found during water quality monitoring activities. The chemical abstract service (CAS) number is a unique identifier for each chemical.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CYANAZINE			0.01 ug/L	21725-46-2
DCPA DI-ACID DEGRADATE			0.00 ug/L	2136-79-0
BORON	2.20 mg/L		10.00 ug/L	11113-50-1
2,4,6-TRICHLOROPHENOL	0.08 mg/L		20.00 ug/L	88-06-2
2,4-DICHLOROPHENOL	0.07 mg/L		20.00 ug/L	120-83-2
2,4-DINITROPHENOL	0.05 mg/L		20.00 ug/L	51-28-5
2,4-DINITROTOLUENE	0.00 mg/L		5.00 ug/L	121-14-2
2,6-DINITROTOLUENE	0.00 mg/L		5.00 ug/L	606-20-2
2-METHYLPHENOL	0.05 mg/L		5.00 ug/L	95-48-7
ACETOCHLOR			0.01 ug/L	34256-82-1
1,2-DIPHENYLHYDRAZINE	0.00 mg/L		0.10 ug/L	122-66-7
1,3-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	542-75-6
PROPAZINE			0.01 ug/L	139-40-2
RDX	0.01 mg/L		0.10 ug/L	121-82-4
TERBACIL			0.01 ug/L	5902-51-2
TERBUFOS			0.01 ug/L	13071-79-9
DCPA MONO-ACID DEGRADATE			0.00 ug/L	887-54-7
DDE	0.00 mg/L		0.01 ug/L	72-55-9
DIAZINON	0.02 mg/L		0.01 ug/L	333-41-5
DISULFOTON	0.00 mg/L		0.01 ug/L	298-04-4
DIURON	0.05 mg/L		0.05 ug/L	330-54-1
EPTC	0.61 mg/L		0.01 ug/L	759-94-4
FONOFOS			0.01 ug/L	944-22-9
LINURON			0.01 ug/L	330-55-2
MOLINATE	0.05 mg/L		0.01 ug/L	2212-67-1
NITROBENZENE	0.01 mg/L		0.10 ug/L	98-95-3
ORGANOTINS				
PERCHLORATE				14797-73-0

INORGANICS

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLORIDE		\$290.113	125.00 mg/L	16887-00-6
CHROMIUM	0.10 mg/L	\$290.103(1)	50.00 ug/L	11104-59-9
COPPER	1.30 mg/L	\$290.120	65.00 ug/L	17493-86-6
CYANIDE	0.20 mg/L	\$290.103(1)	0.01 mg/L	57-12-5
BERYLLIUM	0.00 mg/L	\$290.103(1)	2.00 ug/L	14701-08-7
BROMIDE				
CADMIUM	0.01 mg/L	\$290.103(1)	2.50 ug/L	22537-48-0
ALUMINUM	24.44 mg/L	\$290.113	0.10 ug/L	14903-36-7
ANTIMONY	0.01 mg/L	\$290.103(1)	3.00 ug/L	64924-52-3
ARSENIC	0.05 mg/L	\$290.103(1)	10.00 ug/L	15584-04-0
ASBESTOS	7.00 mg/L		-9,999.00 ug/L	1332-21-4
BARIUM	2.00 mg/L	\$290.103(1)	1,000.00 ug/L	16541-35-8
SELENIUM	0.05 mg/L	\$290.103(1)	25.00 ug/L	7782-49-2
SILVER	0.12 mg/L	\$290.113	25.00 ug/L	14701-21-4
SULFATE	500.00 mg/L	\$290.113	125.00 mg/L	14808-79-8
TDS		\$290.113	250.00 mg/L	
THALLIUM	0.00 mg/L	\$290.103(1)	1.00 ug/L	7440-28-0
ZINC	7.33 mg/L	\$290.113	2.50 ug/L	15176-26-8
FLUORIDE	4.00 mg/L	\$290.103(1)	2.00 mg/L	16984-48-8
HYDROGEN SULFIDE		\$290.113	0.00 mg/L	15035-72-0

IRON		\$290.113	150.00 ug/L	15438-31-0
LEAD	0.02 mg/L	\$290.120	0.00 ug/L	14701-27-0
MANGANESE	1.15 mg/L	\$290.113	25.00 ug/L	14333-14-3
MERCURY	0.00 mg/L	\$290.103(1)	1.00 ug/L	14302-87-5
NICKEL	0.49 mg/L	\$290.103(1)	50.00 ug/L	14701-22-5
NITRATE	10.00 mg/L	\$290.103(1)	3.00 mg/L	14797-55-8
NITRATE+NITRITE	10.00 mg/L	\$290.103(1)	3.00 mg/L	none
NITRITE	1.00 mg/L	\$290.103(1)	0.50 mg/L	14797-65-0

INORGANICS MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CARBONATE			1.00 mg/L	3812-32-6
BICARBONATE			1.00 mg/L	71-52-3
ALKALINITY			1.00 mg/L	
SPECIFIC CONDUCTANCE			1.00 uS/cm	
MAGNESIUM			0.01 mg/L	14581-92-1

INORGANICS UNREGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CALCIUM			0.02 mg/L	14102-48-8
SODIUM			0.20 mg/L	17341-25-2

PHYSICAL

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
HARDNESS			1.00 mg/L	

PHYSICAL PARAMETER

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
pH		\$290.113	0.10 pH	

RADIOCHEM

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
RADIUM-226	5.00 mg/L	\$290.110	1.00 pCi/L	13982-63-3
RADIUM-228	5.00 mg/L	\$290.110	0.50 pCi/L	15262-20-1
STRONTIUM-90		\$290.110	0.50 pCi/L	10098-97-2
TRITIUM		\$290.110	1.00 pCi/L	15086-10-9
GROSS ALPHA	15.00 mg/L	\$290.110	3.00 pCi/L	
GROSS BETA	4.00 mg/L	\$290.110	3.00 pCi/L	

RADIOCHEM UNREGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
RADON	300.00 mg/L		0.50 pCi/L	10043-92-2
STRONTIUM-89			0.50 pCi/L	14701-18-9
URANIUM	0.02 mg/L		1.00 ug/L	none

SOC MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHRYSENE	0.13 mg/L		0.10 ug/L	218-01-9
BENZO[B]FLUORANTHENE	0.00 mg/L		10.00 ug/L	205-99-2
BENZO[G,H,I]PERYLENE	0.73 mg/L		10.00 ug/L	191-24-2
BENZO[K]FLUORANTHENE	0.01 ug/L		10.00 ug/L	207-08-9
BROMACIL			0.05 ug/L	314-40-9
BUTACHLOR			0.05 ug/L	23184-66-9
BUTYL BENZYL PHTHALATE	4.89 mg/L		5.00 ug/L	85-68-7

CARBARYL	2.44 mg/L	0.01 ug/L	63-25-2
2,4,5-T	0.24 mg/L	0.05 ug/L	93-76-5
3-HYDROXYCARBOFURAN		0.05 ug/L	16655-82-6
ACENAPHTHENE	1.47 mg/L	5.00 ug/L	83-32-9
ACENAPHTHYLENE	1.47 mg/L	5.00 ug/L	208-96-8
ALDRIN	0.00 mg/L	0.10 ug/L	309-00-2
ANTHRACENE	7.33 mg/L	5.00 ug/L	120-12-7
BENTAZON		0.05 ug/L	25057-89-0
BENZO[A]ANTHRACENE	0.00 mg/L	10.00 ug/L	56-55-3
PHENANTHRENE		5.00 ug/L	85-01-8
PROMETON		0.01 ug/L	1610-18-0
PROPACHLOR		0.01 ug/L	1918-16-7
PYRENE	0.73 mg/L	0.10 ug/L	129-00-0
TRIFLURALIN	0.12 mg/L	0.01 ug/L	1582-09-8
DIBENZ[A,H]ANTHRACENE	0.00 mg/L	10.00 ug/L	53-70-3
DICAMBA	0.73 mg/L	0.05 ug/L	1918-00-9
DIELDRIN	0.00 mg/L	0.01 ug/L	60-57-1
DIETHYL PHTHALATE	19.55 mg/L	5.00 ug/L	84-66-2
DIMETHYL PHTHALATE	19.55 mg/L	5.00 ug/L	131-11-3
DI-N-BUTYL PHTHALATE	2.44 mg/L	5.00 ug/L	84-74-2
FLUORENE	0.98 mg/L	0.10 ug/L	86-73-7
INDENO[1,2,3,CD]PYRENE		10.00 ug/L	193-39-5
LAMBAST		0.05 ug/L	845-52-3
METHIOCARB		0.05 ug/L	2032-65-7
METHOMYL	0.61 mg/L	0.05 ug/L	16752-77-5
METOLACHLOR	3.67 mg/L	0.01 ug/L	51218-45-2
METRIBUZIN		0.01 ug/L	21087-64-9

SOC REGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLORDANE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	57-74-9
CHLORDANE (ALPHA-CHLORDANE)	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	5103-71-9
CHLORDANE (GAMMA-CHLORDANE)	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	12789-03-6
CHLORDANE (TRANS-NONACHLOR)	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	39765-80-5
DALAPON	0.20 mg/L	\$290.103(3)(A)	0.05 mg/L	75-99-0
CARBOFURAN	0.04 mg/L	\$290.103(3)(A)	0.01 ug/L	1563-66-2
2,3,7,8-TCDD	0.00 mg/L	\$290.103(3)(A)	0.10 mg/L	1746-01-6
2,4,5-TP	0.05 mg/L	\$290.103(3)(A)	0.05 ug/L	93-72-1
2,4-D	0.07 mg/L	\$290.103(3)(A)	0.15 ug/L	94-75-7
ALACHLOR	0.00 mg/L	\$290.103(3)(A)	0.01 ug/L	15972-60-8
ALDICARB	0.01 mg/L	\$290.103(3)(A)	0.55 ug/L	116-06-3
ALDICARB SULFONE	0.01 mg/L	\$290.103(3)(A)	0.10 ug/L	1646-88-4
ALDICARB SULFOXIDE	0.01 mg/L	\$290.103(3)(A)	0.05 ug/L	1646-87-3
ATRAZINE	0.00 mg/L	\$290.103(3)(A)	0.01 ug/L	1912-24-9
BENZO(A)PYRENE	0.00 mg/L	\$290.103(3)(A)	10.00 ug/L	50-32-8
PICLORAM	0.50 mg/L	\$290.103(3)(A)	0.05 ug/L	1918-02-1
SIMAZINE	0.00 mg/L		0.01 ug/L	122-34-9
TOXAPHENE	0.00 mg/L	\$290.103(3)(A)	2.00 ug/L	8001-35-2
DI-(2-ETHYLHEXYL)ADIPATE	0.40 mg/L	\$290.103(3)(A)	5.00 ug/L	103-23-1
DI-(2-ETHYLHEXYL)PHTHALATE	0.01 mg/L	\$290.103(3)(A)	5.00 ug/L	117-81-7
DIBROMOCHLOROPROPANE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	67708-83-2
DINOSEB	0.01 mg/L	\$290.103(3)(A)	0.05 ug/L	88-85-7
DIQUAT	0.02 mg/L	\$290.103(3)(A)	0.05 mg/L	2764-72-9
ENDOTHALL	0.10 mg/L	\$290.103(3)(A)	0.05 ug/L	145-73-3
ENDRIN	0.00 mg/L	\$290.103(3)(A)	0.05 ug/L	72-20-8
ETHYLENE DIBROMIDE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	106-93-4
GLYPHOSATE	0.70 mg/L	\$290.103(3)(A)	0.05 ug/L	1071-83-6
HEPTACHLOR	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	76-44-8
HEPTACHLOR EPOXIDE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	1024-57-3
HEXACHLOROBENZENE	0.00 mg/L	\$290.103(3)(A)	5.00 ug/L	118-74-1
HEXACHLOROCYCLOPENTADIENE	0.05 mg/L	\$290.103(3)(A)	5.00 ug/L	77-47-4

LINDANE	0.00 mg/L	\$290.103(3)(A)	0.01 ug/L	58-89-9
METHOXYCHLOR	0.04 mg/L	\$290.103(3)(A)	0.05 ug/L	72-43-5
OXAMYL	0.20 mg/L	\$290.103(3)(A)	0.05 ug/L	23135-22-0
PCBs	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	53469-21-9
PENTACHLOROPHENOL	0.00 mg/L	\$290.103(3)(A)	30.00 ug/L	87-86-5

THM

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROFORM	0.10 mg/L	\$290.116	0.10 ug/L	67-66-3
BROMOCHLOROMETHANE	0.98 mg/L		0.10 ug/L	74-97-5
BROMODICHLOROMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	75-27-4
BROMOFORM	0.10 mg/L	\$290.116	0.10 ug/L	75-25-2
BROMOMETHANE	0.03 mg/L		0.10 ug/L	74-83-9
DIBROMOCHLOROMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	124-48-1

VOC - OTHER COMPOUNDS

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CARBON DISULFIDE	2.44 mg/L		0.10 ug/L	75-15-0
2-HEXANONE	1.47 mg/L		0.10 ug/L	591-78-6
4-METHYL-2-PENTANONE (MIBK)	1.96 mg/L		0.10 ug/L	108-10-1
ACETONE	2.44 mg/L		0.10 ug/L	67-64-1
ACRYLONITRILE	0.00 mg/L		0.10 ug/L	107-13-1
TETRAHYDROFURAN	0.12 mg/L		0.10 ug/L	109-99-9
VINYL ACETATE	24.44 mg/L		0.10 ug/L	108-05-4
ETHYL METHACRYLATE	2.20 mg/L		0.10 ug/L	97-63-2
METHYL IODIDE (Iodomethane)	0.03 mg/L		0.10 ug/L	74-88-4
METHYL ETHYL KETONE	14.67 mg/L		0.10 ug/L	78-93-3
METHYL METHACRYLATE	34.22 mg/L		0.10 ug/L	80-62-6
METHYL-T-BUTYL ETHER	0.24 mg/L		0.10 ug/L	1634-04-4

VOC MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROETHANE	9.78 mg/L		0.10 ug/L	75-00-3
CHLOROMETHANE	0.07 mg/L		0.10 ug/L	74-87-3
CIS-1,3-DICHLOROPROPENE	0.00 mg/L		0.10 ug/L	10061-01-5
BROMOBENZENE	0.49 mg/L		0.10 ug/L	108-86-1
2-CHLOROTOLUENE	0.49 mg/L		0.10 ug/L	95-49-8
4-CHLOROTOLUENE	0.49 mg/L		0.10 ug/L	106-43-4
4-ISOPROPYLTOLUENE	2.44 mg/L		0.10 ug/L	99-87-6
1,1,1,2-TETRACHLOROETHANE	0.04 mg/L		0.10 ug/L	630-20-6
1,1,2,2-TETRACHLOROETHANE	0.17 mg/L		0.10 ug/L	79-34-5
1,1-DICHLOROETHANE	2.44 mg/L		0.10 ug/L	75-34-3
1,1-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	563-58-6
1,2,3-TRICHLOROBENZENE	0.07 mg/L		0.10 ug/L	87-61-6
1,2,3-TRICHLOROPROPANE	0.00 mg/L		0.10 ug/L	96-18-4
1,2,4-TRIMETHYLBENZENE	1.22 mg/L		0.10 ug/L	95-63-6
1,3,5-TRIMETHYLBENZENE	1.22 mg/L		0.10 ug/L	108-67-8
1,3-DICHLOROBENZENE	0.73 mg/L		0.10 ug/L	541-73-1
1,3-DICHLOROPROPANE	0.01 mg/L		0.10 ug/L	142-28-9
2,2-DICHLOROPROPANE			0.10 ug/L	594-20-7
S-BUTYLBENZENE	0.98 mg/L		0.10 ug/L	135-98-8
T-BUTYLBENZENE	0.98 mg/L		0.10 ug/L	98-06-6
TRANS-1,3-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	10061-02-6
TRICHLOROFLUOROMETHANE	7.33 mg/L		0.10 ug/L	75-69-4
DIBROMOMETHANE	0.12 mg/L		0.10 ug/L	74-95-3
DICHLORODIFLUOROMETHANE	4.89 mg/L		0.10 ug/L	75-71-8
HEXACHLOROBUTADIENE	0.00 ug/L		0.10 ug/L	87-68-3
ISOPROPYLBENZENE	2.44 mg/L		0.10 ug/L	98-82-8

M + P XYLENE		0.10 ug/L	106-42-3
NAPHTHALENE	0.49 mg/L	0.10 ug/L	91-20-3
N-BUTYLBENZENE	0.98 mg/L	0.10 ug/L	104-51-8
N-PROPYLBENZENE	0.98 mg/L	0.10 ug/L	103-65-1

VOC REGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROBENZENE (MONOCHLOROBENZENE)	0.10 mg/L		0.10 ug/L	108-90-7
CIS-1,2-DICHLOROETHYLENE	0.07 mg/L	\$290.103(3)(B)	0.10 ug/L	156-59-2
CARBON TETRACHLORIDE	0.00 mg/L	\$290.103(3)(B)	0.10 ug/L	56-23-5
1,1,1-TRICHLOROETHANE	0.20 mg/L	\$290.103(3)(B)	0.10 ug/L	71-55-6
1,1,2-TRICHLOROETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	79-00-5
1,1-DICHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	75-35-4
1,2,4-TRICHLOROBENZENE	0.07 mg/L	\$290.103(3)(B)	0.10 ug/L	120-82-1
1,2-DICHLOROETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	107-06-2
1,2-DICHLOROPROPANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	78-87-5
BENZENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	71-43-2
P-XYLENE		\$290.103(3)(B)	0.10 ug/L	106-42-3
STYRENE	0.10 mg/L	\$290.103(3)(B)	0.10 ug/L	100-42-5
TETRACHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	127-18-4
TOLUENE	1.00 mg/L	\$290.103(3)(B)	0.10 ug/L	108-88-3
TRANS-1,2-DICHLOROETHYLENE	0.10 mg/L	\$290.103(3)(B)	0.10 ug/L	156-60-5
TRICHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	79-01-6
VINYL CHLORIDE	0.00 mg/L	\$290.103(3)(B)	0.10 ug/L	75-01-4
XYLENES (TOTAL)	10.00 mg/L	\$290.103(3)(B)	0.10 ug/L	none
DICHLOROMETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	75-09-2
ETHYLBENZENE	0.70 mg/L	\$290.103(3)(B)	0.10 ug/L	100-41-4
MONOCHLOROBENZENE (CHLOROBENZENE)		\$290.103(3)(B)	0.10 ug/L	108-90-7
M-XYLENE	10.00 mg/L		0.10 mg/L	108-38-3
ORTHO-1,2-DICHLOROBENZENE	0.60 mg/L	\$290.103(3)(B)	0.10 ug/L	95-50-1
O-XYLENE		\$290.103(3)(B)	0.10 mg/L	95-47-6
PARA-1,4-DICHLOROBENZENE	0.08 mg/L	\$290.103(3)(B)	0.10 ug/L	106-46-7

Other

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CRYPTOSPORIDIUM PARVUM				
AROCLOR (PCB)			0.05 ug/L	53469-21-9
TOTAL ALPHA EMITTING RADIUM	5.00 mg/L	\$290.110		
TOTAL COLIFORM				
TOTAL TRIHALOMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	
TRIAZINES				
ESCHERICHIA COLI				
FECAL VIRUSES				
GIARDIA LAMBLIA				
P-ALKALINITY				

Map Legend

Water System Sources

Source Type

Source Type

-  Surface Water
-  Ground Water

Capture Zones

Travel Time

-  2 Years
-  5 Years
-  10 Years
-  20 Years
-  50 Years
-  100 Years
-  Other

Truncated Watersheds



Potential Sources of Contamination

Type Description

-  ANIMAL FEEDING OPERATION
-  BUSINESS
-  CEMETERY
-  CHEMICAL PIPELINE
-  CHEMICAL STORAGE
-  CLASS I INJECTION WELL
-  CLASS II INJECTION WELL
-  CLASS III INJECTION WELL
-  CLASS IV INJECTION WELL
-  CLASS V INJECTION WELL
-  GUN RANGE
-  NATURAL RESOURCE PRODUCTION

API



 TRANSPORTATION

 WASTE

 WASTEWATER
