

Susceptibility Report for System ID 2120034

System Details

Water System ID	2120034
System Name	MOUNT SYLVAN WATER SYSTEM
Address	7891 US HIGHWAY 271 TYLER, TX 757084002
County	SMITH
Telephone	9039208421
PWS Type	C
Total Production	0

Ground Water Sources

Source ID	Drill Date	Top Screened Interval (Ft.)	Bottom Screened Interval (Ft.)	Pumpage Rate (GPM)	Entry Point	Operational Status
G2120034A		720	798	26	001	Operational
G2120034B		787	829	23	001	Operational
G2120034C		98	158	82	002	Operational
G2120034D		72	160	13	002	Operational

Surface Water Sources

Source ID	Type	Surface Water Body	Entry Point	Operational Status
No surface water sources				

PWS System Susceptibility Summary: Contaminants with HIGH Susceptibility

The system is rated as having HIGH susceptibility to the contaminants listed below.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
BORON	----	Moderate	High	----	----	----	High

INORGANICS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
ZINC	Low	Moderate	High	----	----	----	High
TDS	Low	Moderate	Moderate	----	----	High	High

INORGANICS MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
SPECIFIC CONDUCTANCE	----	Moderate	High	----	----	----	High

PHYSICAL

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
HARDNESS	----	Moderate	High	----	----	----	High

PWS System Susceptibility Summary: Contaminants with MODERATE Susceptibility

The system is rated as having MODERATE susceptibility to the contaminants listed below.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2,4,6-TRICHLOROPHENOL	----	Moderate	----	----	----	----	Moderate
2,4-DICHLOROPHENOL	----	Moderate	Low	----	----	----	Moderate
2,4-DINITROPHENOL	----	Moderate	Low	----	----	----	Moderate
2,4-DINITROTOLUENE	----	Moderate	----	----	----	----	Moderate

2,6-DINITROTOLUENE	----	Moderate	----	----	----	----	Moderate
2-METHYLPHENOL	----	Moderate	----	----	----	----	Moderate
ACETOCHLOR	----	Moderate	Low	----	----	----	Moderate
CYANAZINE	----	Moderate	Low	----	----	----	Moderate
DCPA DI-ACID DEGRADATE	----	Moderate	Low	----	----	----	Moderate
DCPA MONO-ACID DEGRADATE	----	Moderate	Low	----	----	----	Moderate
DDE	----	Moderate	Low	----	----	----	Moderate
DIAZINON	----	Moderate	Low	----	----	----	Moderate
DISULFOTON	----	Moderate	Low	----	----	----	Moderate
DIURON	----	Moderate	Low	----	----	----	Moderate
EPTC	----	Moderate	Low	----	----	----	Moderate
FONOFOS	----	Moderate	Low	----	----	----	Moderate
LINURON	----	Moderate	Low	----	----	----	Moderate
MOLINATE	----	Moderate	Low	----	----	----	Moderate
NITROBENZENE	----	Moderate	----	----	----	----	Moderate
ORGANOTINS	----	Moderate	----	----	----	----	Moderate
PERCHLORATE	----	Moderate	----	----	----	----	Moderate
PROPAZINE	----	Moderate	Low	----	----	----	Moderate
RDX	----	Moderate	----	----	----	----	Moderate
TERBACIL	----	Moderate	Low	----	----	----	Moderate
TERBUFOS	----	Moderate	Low	----	----	----	Moderate
1,2-DIPHENYLHYDRAZINE	----	Moderate	----	----	----	----	Moderate
1,3-DICHLOROPROPENE	----	Moderate	Low	----	----	----	Moderate

INORGANICS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
ALUMINUM	Low	Moderate	Moderate	----	----	----	Moderate
ANTIMONY	----	Moderate	----	----	----	----	Moderate
ARSENIC	Low	Moderate	----	----	----	----	Moderate
ASBESTOS	----	Moderate	----	----	----	----	Moderate
BARIUM	Low	Moderate	----	----	----	----	Moderate
BERYLLIUM	----	Moderate	Low	----	----	----	Moderate
BROMIDE	Low	Moderate	----	----	----	----	Moderate
CADMIUM	----	Moderate	----	----	----	----	Moderate
CHLORIDE	Low	Moderate	Low	----	----	----	Moderate
CHROMIUM	----	Moderate	----	----	----	----	Moderate
COPPER	Low	Moderate	Low	----	----	----	Moderate
CYANIDE	----	Moderate	----	----	----	----	Moderate
FLUORIDE	Low	Moderate	----	----	----	----	Moderate
HYDROGEN SULFIDE	----	Moderate	----	----	----	----	Moderate
IRON	Low	Moderate	Low	----	----	----	Moderate
LEAD	----	Moderate	Low	----	----	----	Moderate
MANGANESE	Low	Moderate	Low	----	----	----	Moderate
MERCURY	----	Moderate	----	----	----	----	Moderate
NICKEL	----	Moderate	Low	----	----	----	Moderate
NITRATE	Low	Moderate	Low	----	----	----	Moderate
NITRATE+NITRITE	Low	Moderate	Low	----	----	----	Moderate
NITRITE	Low	Moderate	Low	----	----	----	Moderate
SELENIUM	----	Moderate	----	----	----	----	Moderate
SILVER	----	Moderate	----	----	----	----	Moderate
SULFATE	Low	Moderate	Low	----	----	----	Moderate
THALLIUM	----	Moderate	----	----	----	----	Moderate

INORGANICS MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
ALKALINITY	----	Moderate	----	----	----	----	Moderate
BICARBONATE	----	Moderate	----	----	----	----	Moderate
CARBONATE	----	Moderate	----	----	----	----	Moderate
MAGNESIUM	----	Moderate	----	----	----	----	Moderate

INORGANICS UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
CALCIUM	----	Moderate	----	----	----	----	Moderate
SODIUM	Low	Moderate	Low	----	----	----	Moderate

PHYSICAL PARAMETER

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
pH	----	Moderate	----	----	----	----	Moderate

RADIOCHEM

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
TRITIUM	----	Moderate	----	----	----	----	Moderate
GROSS ALPHA	----	Moderate	----	----	----	----	Moderate
GROSS BETA	----	Moderate	----	----	----	----	Moderate
RADIUM-226	----	Moderate	----	----	----	----	Moderate
RADIUM-228	----	Moderate	----	----	----	----	Moderate
STRONTIUM-90	----	Moderate	----	----	----	----	Moderate

RADIOCHEM UNREGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
URANIUM	----	Moderate	----	----	----	----	Moderate
RADON	----	Moderate	----	----	----	----	Moderate
STRONTIUM-89	----	Moderate	----	----	----	----	Moderate

SOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
3-HYDROXYCARBOFURAN	----	Moderate	Low	----	----	----	Moderate
ACENAPHTHENE	----	Moderate	Low	----	----	----	Moderate
ACENAPHTHYLENE	----	Moderate	----	----	----	----	Moderate
ALDRIN	----	Moderate	Low	----	----	----	Moderate
ANTHRACENE	----	Moderate	Low	----	----	----	Moderate
BENTAZON	----	Moderate	Low	----	----	----	Moderate
BENZO[A]ANTHRACENE	----	Moderate	----	----	----	----	Moderate
BENZO[B]FLUORANTHENE	----	Moderate	----	----	----	----	Moderate
BENZO[G,H,I]PERYLENE	----	Moderate	----	----	----	----	Moderate
BENZO[K]FLUORANTHENE	----	Moderate	----	----	----	----	Moderate
BROMACIL	----	Moderate	Low	----	----	----	Moderate
BUTACHLOR	----	Moderate	Low	----	----	----	Moderate
BUTYL BENZYL PHTHALATE	----	Moderate	----	----	----	----	Moderate
CARBARYL	----	Moderate	Moderate	----	----	----	Moderate
CHRYSENE	----	Moderate	Low	----	----	----	Moderate
TRIFLURALIN	----	Moderate	Low	----	----	----	Moderate
DIBENZ[A,H]ANTHRACENE	----	Moderate	----	----	----	----	Moderate
DICAMBA	----	Moderate	Low	----	----	----	Moderate
DIELDRIN	----	Moderate	Low	----	----	----	Moderate
DIETHYL PHTHALATE	----	Moderate	Low	----	----	----	Moderate
DIMETHYL PHTHALATE	----	Moderate	Low	----	----	----	Moderate
DI-N-BUTYL PHTHALATE	----	Moderate	----	----	----	----	Moderate
FLUORENE	----	Moderate	----	----	----	----	Moderate
INDENO[1,2,3,CD]PYRENE	----	Moderate	----	----	----	----	Moderate
LAMBAST	----	Moderate	Low	----	----	----	Moderate
METHIOCARB	----	Moderate	Low	----	----	----	Moderate
METHOMYL	----	Moderate	Low	----	----	----	Moderate
METOLACHLOR	----	Moderate	Low	----	----	----	Moderate
METRIBUZIN	----	Moderate	Low	----	----	----	Moderate
PHENANTHRENE	----	Moderate	----	----	----	----	Moderate
PROMETON	----	Moderate	Low	----	----	----	Moderate
PROPACHLOR	----	Moderate	Low	----	----	----	Moderate
PYRENE	----	Moderate	----	----	----	----	Moderate
2,4,5-T	----	Moderate	Low	----	----	----	Moderate

SOC REGULATED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2,4-D	----	Moderate	Moderate	----	----	----	Moderate
ALACHLOR	----	Moderate	Low	----	----	----	Moderate
ALDICARB	----	Moderate	Low	----	----	----	Moderate

ALDICARB SULFONE	----	Moderate	Low	----	----	----	Moderate
ALDICARB SULFOXIDE	----	Moderate	Low	----	----	----	Moderate
ATRAZINE	----	Moderate	Low	----	----	----	Moderate
BENZO(A)PYRENE	----	Moderate	----	----	----	----	Moderate
CARBOFURAN	----	Moderate	Low	----	----	----	Moderate
CHLORDANE	----	Moderate	Low	----	----	----	Moderate
CHLORDANE (ALPHA-CHLORDANE)	----	Moderate	Low	----	----	----	Moderate
CHLORDANE (GAMMA-CHLORDANE)	----	Moderate	Low	----	----	----	Moderate
CHLORDANE (TRANS-NONACHLOR)	----	Moderate	Low	----	----	----	Moderate
TOXAPHENE	----	Moderate	Low	----	----	----	Moderate
DALAPON	----	Moderate	Low	----	----	----	Moderate
DI-(2-ETHYLHEXYL)ADIPATE	----	Moderate	Low	----	----	----	Moderate
DI-(2-ETHYLHEXYL)PHTHALATE	----	Moderate	Low	----	----	----	Moderate
DIBROMOCHLOROPROPANE	----	Moderate	Low	----	----	----	Moderate
DINOSEB	----	Moderate	Low	----	----	----	Moderate
DIQUAT	----	Moderate	Low	----	----	----	Moderate
ENDOTHALL	----	Moderate	Low	----	----	----	Moderate
ENDRIN	----	Moderate	Low	----	----	----	Moderate
ETHYLENE DIBROMIDE	----	Moderate	----	----	----	----	Moderate
GLYPHOSATE	----	Moderate	Low	----	----	----	Moderate
HEPTACHLOR	----	Moderate	Low	----	----	----	Moderate
HEPTACHLOR EPOXIDE	----	Moderate	Low	----	----	----	Moderate
HEXACHLOROBENZENE	----	Moderate	Low	----	----	----	Moderate
HEXACHLOROCYCLOPENTADIENE	----	Moderate	Low	----	----	----	Moderate
LINDANE	----	Moderate	Low	----	----	----	Moderate
METHOXYCHLOR	----	Moderate	Low	----	----	----	Moderate
OXAMYL	----	Moderate	Low	----	----	----	Moderate
PCBs	----	Moderate	----	----	----	----	Moderate
PENTACHLOROPHENOL	----	Moderate	----	----	----	----	Moderate
PICLORAM	----	Moderate	Moderate	----	----	----	Moderate
SIMAZINE	----	Moderate	Low	----	----	----	Moderate
2,3,7,8-TCDD	----	Moderate	----	----	----	----	Moderate
2,4,5-TP	----	Moderate	Low	----	----	----	Moderate

THM

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
BROMOCHLOROMETHANE	----	Moderate	----	----	----	----	Moderate
BROMODICHLOROMETHANE	----	Moderate	----	----	----	----	Moderate
BROMOFORM	----	Moderate	----	----	----	----	Moderate
BROMOMETHANE	----	Moderate	Low	----	----	----	Moderate
CHLOROFORM	----	Moderate	Low	----	----	----	Moderate
DIBROMOCHLOROMETHANE	----	Moderate	----	----	----	----	Moderate

VOC - OTHER COMPOUNDS

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2-HEXANONE	----	Moderate	----	----	----	----	Moderate
4-METHYL-2-PENTANONE (MIBK)	----	Moderate	----	----	----	----	Moderate
ACETONE	----	Moderate	----	----	----	----	Moderate
ACRYLONITRILE	----	Moderate	----	----	----	----	Moderate
CARBON DISULFIDE	----	Moderate	Low	----	----	----	Moderate
VINYL ACETATE	----	Moderate	----	----	----	----	Moderate
ETHYL METHACRYLATE	----	Moderate	----	----	----	----	Moderate
METHYL IODIDE (Iodomethane)	----	Moderate	Low	----	----	----	Moderate
METHYL ETHYL KETONE	----	Moderate	----	----	----	----	Moderate
METHYL METHACRYLATE	----	Moderate	----	----	----	----	Moderate
METHYL-T-BUTYL ETHER	----	Moderate	----	----	----	----	Moderate
TETRAHYDROFURAN	----	Moderate	----	----	----	----	Moderate

VOC MONITORED

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
2-CHLOROTOLUENE	----	Moderate	Low	----	----	----	Moderate
4-CHLOROTOLUENE	----	Moderate	----	----	----	----	Moderate

4-ISOPROPYLTOLUENE	----	Moderate	----	----	----	----	Moderate
BROMOBENZENE	----	Moderate	----	----	----	----	Moderate
CHLOROETHANE	----	Moderate	Low	----	----	----	Moderate
CHLOROMETHANE	----	Moderate	----	----	----	----	Moderate
TRANS-1,3-DICHLOROPROPENE	----	Moderate	Low	----	----	----	Moderate
TRICHLOROFLUOROMETHANE	----	Moderate	Low	----	----	----	Moderate
CIS-1,3-DICHLOROPROPENE	----	Moderate	Low	----	----	----	Moderate
DIBROMOMETHANE	----	Moderate	----	----	----	----	Moderate
DICHLORODIFLUOROMETHANE	----	Moderate	Low	----	----	----	Moderate
HEXACHLOROBUTADIENE	----	Moderate	----	----	----	----	Moderate
ISOPROPYLBENZENE	----	Moderate	----	----	----	----	Moderate
M + P XYLENE	----	Moderate	----	----	----	----	Moderate
NAPHTHALENE	----	Moderate	----	----	----	----	Moderate
N-BUTYLBENZENE	----	Moderate	----	----	----	----	Moderate
N-PROPYLBENZENE	----	Moderate	----	----	----	----	Moderate
S-BUTYLBENZENE	----	Moderate	----	----	----	----	Moderate
T-BUTYLBENZENE	----	Moderate	----	----	----	----	Moderate
1,1,1,2-TETRACHLOROETHANE	----	Moderate	----	----	----	----	Moderate
1,1,2,2-TETRACHLOROETHANE	----	Moderate	Low	----	----	----	Moderate
1,1-DICHLOROETHANE	----	Moderate	----	----	----	----	Moderate
1,1-DICHLOROPROPENE	----	Moderate	----	----	----	----	Moderate
1,2,3-TRICHLOROBENZENE	----	Moderate	----	----	----	----	Moderate
1,2,3-TRICHLOROPROPANE	----	Moderate	----	----	----	----	Moderate
1,2,4-TRIMETHYLBENZENE	----	Moderate	----	----	----	----	Moderate
1,3,5-TRIMETHYLBENZENE	----	Moderate	----	----	----	----	Moderate
1,3-DICHLOROBENZENE	----	Moderate	----	----	----	----	Moderate
1,3-DICHLOROPROPANE	----	Moderate	Low	----	----	----	Moderate
2,2-DICHLOROPROPANE	----	Moderate	----	----	----	----	Moderate

VOC REGULATED


Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
BENZENE	----	Moderate	----	----	----	----	Moderate
CARBON TETRACHLORIDE	----	Moderate	Low	----	----	----	Moderate
CHLOROBENZENE (MONOCHLOROBENZENE)	----	Moderate	Low	----	----	----	Moderate
TOLUENE	----	Moderate	Low	----	----	----	Moderate
TRANS-1,2-DICHLOROETHYLENE	----	Moderate	----	----	----	----	Moderate
TRICHLOROETHYLENE	----	Moderate	Low	----	----	----	Moderate
VINYL CHLORIDE	----	Moderate	----	----	----	----	Moderate
XYLENES (TOTAL)	----	Moderate	Low	----	----	----	Moderate
CIS-1,2-DICHLOROETHYLENE	----	Moderate	----	----	----	----	Moderate
DICHLOROMETHANE	----	Moderate	----	----	----	----	Moderate
ETHYLBENZENE	----	Moderate	Low	----	----	----	Moderate
MONOCHLOROBENZENE (CHLOROBENZENE)	----	Moderate	----	----	----	----	Moderate
M-XYLENE	----	Moderate	----	----	----	----	Moderate
ORTHO-1,2-DICHLOROBENZENE	----	Moderate	Low	----	----	----	Moderate
O-XYLENE	----	Moderate	----	----	----	----	Moderate
PARA-1,4-DICHLOROBENZENE	----	Moderate	Low	----	----	----	Moderate
P-XYLENE	----	Moderate	----	----	----	----	Moderate
STYRENE	----	Moderate	----	----	----	----	Moderate
TETRACHLOROETHYLENE	----	Moderate	Low	----	----	----	Moderate
1,1,1-TRICHLOROETHANE	----	Moderate	Low	----	----	----	Moderate
1,1,2-TRICHLOROETHANE	----	Moderate	Low	----	----	----	Moderate
1,1-DICHLOROETHYLENE	----	Moderate	Low	----	----	----	Moderate
1,2,4-TRICHLOROBENZENE	----	Moderate	Low	----	----	----	Moderate
1,2-DICHLOROETHANE	----	Moderate	Low	----	----	----	Moderate
1,2-DICHLOROPROPANE	----	Moderate	Low	----	----	----	Moderate

Other

Contaminant Name	Structural Integrity	Aquifer/Watershed Properties	Nonpoint Source	Point Source	Area Primary Influence	Contaminant Occurrence	Summary
AROCOR (PCB)	----	Moderate	Low	----	----	----	Moderate
TOTAL ALPHA EMITTING RADIUM	----	Moderate	----	----	----	----	Moderate
TOTAL COLIFORM	Low	Moderate	Moderate	----	----	----	Moderate
TOTAL TRIHALOMETHANE	----	Moderate	----	----	----	----	Moderate
TRIAZINES	----	Moderate	Low	----	----	----	Moderate

CRYPTOSPORIDIUM PARVUM	Low	Moderate	Moderate	----	----	----	Moderate
ESCHERICHIA COLI	Low	Moderate	Moderate	----	----	----	Moderate
FECAL VIRUSES	Low	Moderate	Moderate	----	----	----	Moderate
GIARDIA LAMBLIA	Low	Moderate	Moderate	----	----	----	Moderate
P-ALKALINITY	----	Moderate	----	----	----	----	Moderate

Source Details: G2120034A

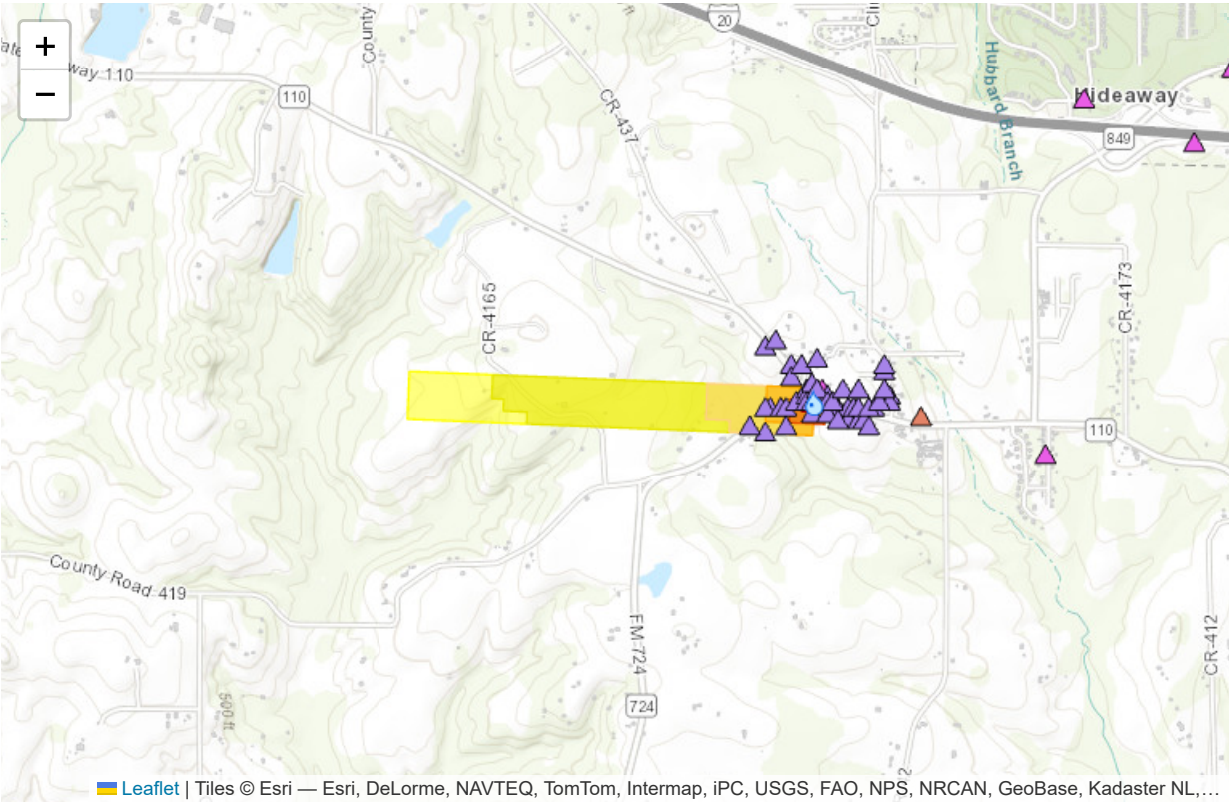


Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Source Details: G2120034B

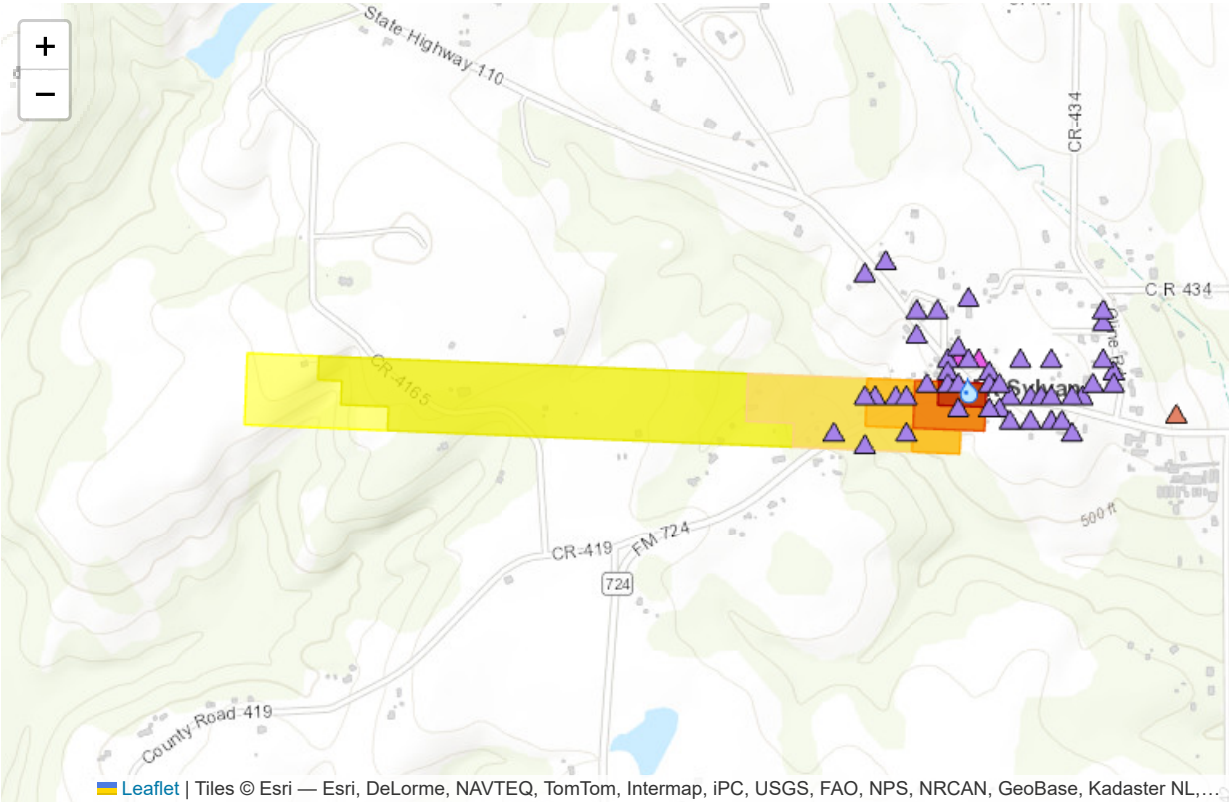


Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Source Details: G2120034C

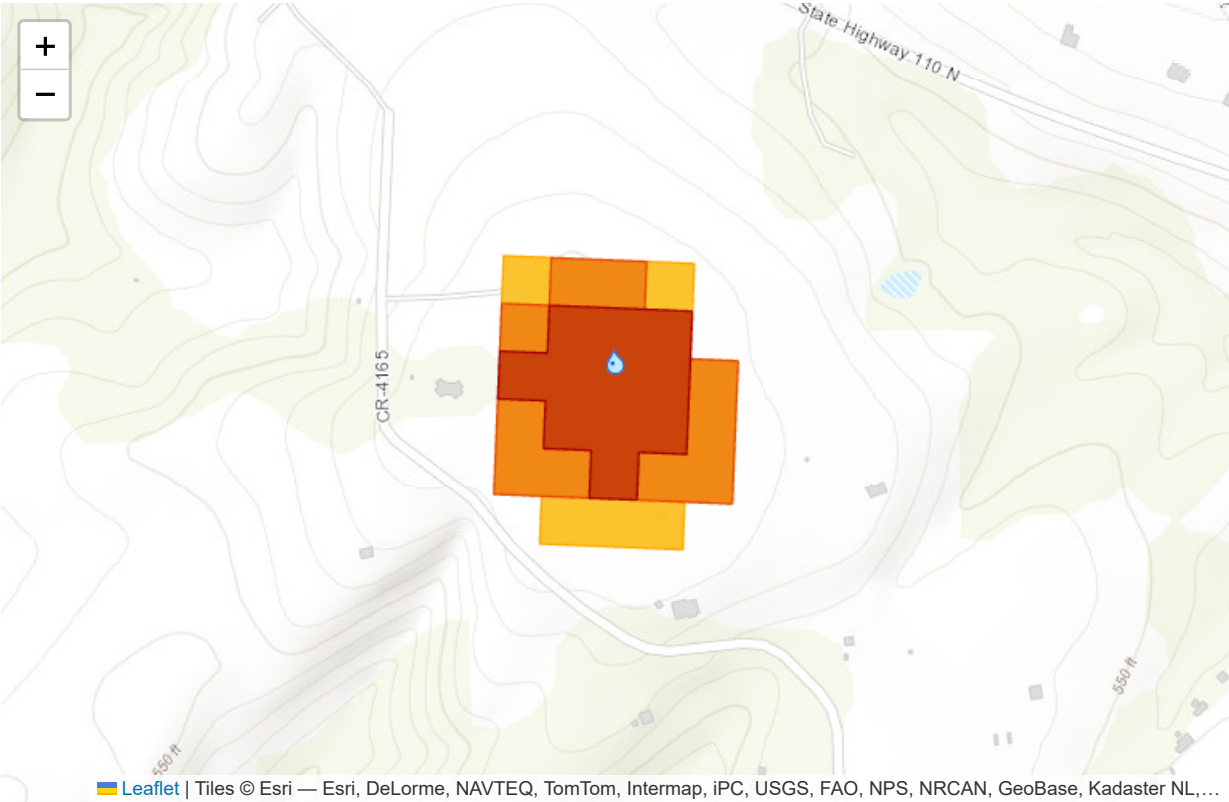


Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Source Details: G2120034D

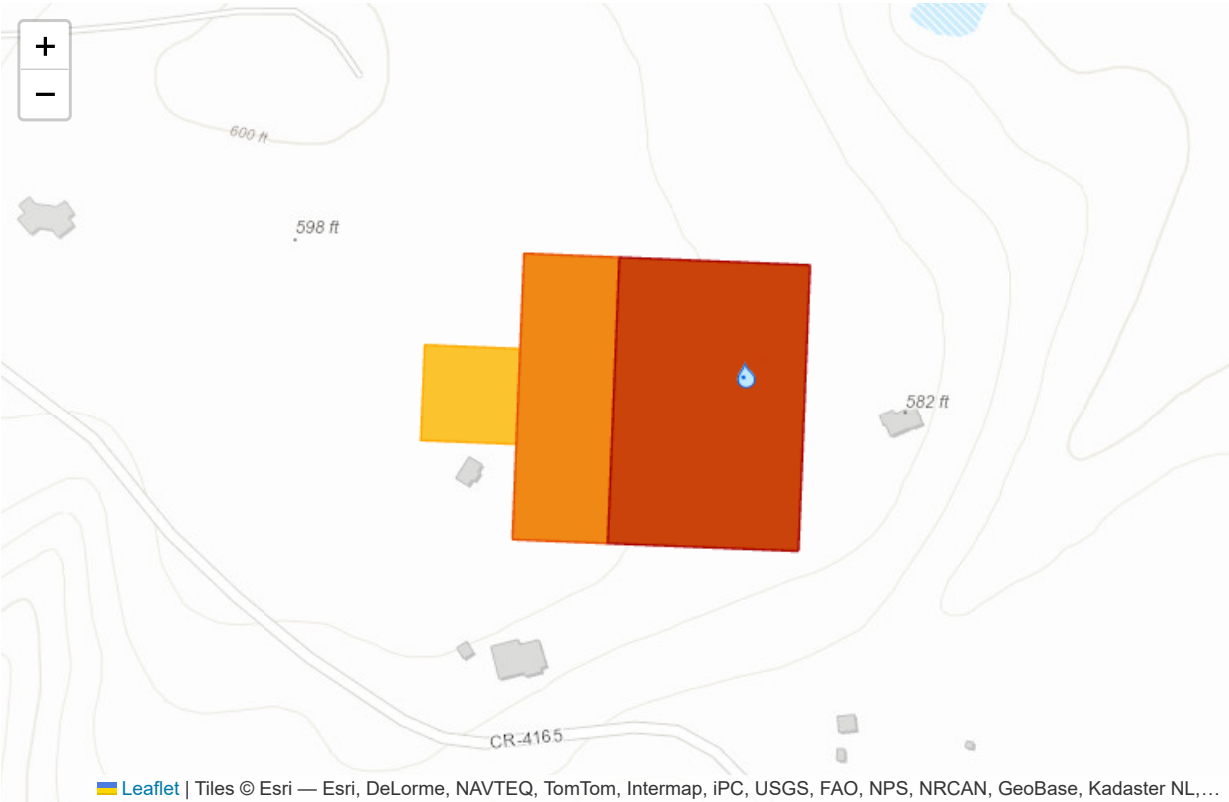

Contaminants with HIGH Susceptibility

No contaminants with high susceptibility.

Contaminants with MODERATE Susceptibility

No contaminants with moderate susceptibility.

Contaminant List

List of regulated and unregulated assessed contaminants grouped by contaminant class. TCEQ Chapter 290 Subchapter F rules are cited for each drinking water standard (secondary drinking water standards are italicized). The TCEQ threshold limit is the concentration used within the contaminant occurrence component to determine if a detection of the chemical was found during water quality monitoring activities. The chemical abstract service (CAS) number is a unique identifier for each chemical.

D.W. CONTAM. CANDIDATE LIST

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CYANAZINE			0.01 ug/L	21725-46-2
DCPA DI-ACID DEGRADATE			0.00 ug/L	2136-79-0
BORON	2.20 mg/L		10.00 ug/L	11113-50-1
2,4,6-TRICHLOROPHENOL	0.08 mg/L		20.00 ug/L	88-06-2
2,4-DICHLOROPHENOL	0.07 mg/L		20.00 ug/L	120-83-2
2,4-DINITROPHENOL	0.05 mg/L		20.00 ug/L	51-28-5
2,4-DINITROTOLUENE	0.00 mg/L		5.00 ug/L	121-14-2
2,6-DINITROTOLUENE	0.00 mg/L		5.00 ug/L	606-20-2
2-METHYLPHENOL	0.05 mg/L		5.00 ug/L	95-48-7
ACETOCHLOR			0.01 ug/L	34256-82-1
1,2-DIPHENYLHYDRAZINE	0.00 mg/L		0.10 ug/L	122-66-7
1,3-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	542-75-6
PROPAZINE			0.01 ug/L	139-40-2
RDX	0.01 mg/L		0.10 ug/L	121-82-4
TERBACIL			0.01 ug/L	5902-51-2
TERBUFOS			0.01 ug/L	13071-79-9
DCPA MONO-ACID DEGRADATE			0.00 ug/L	887-54-7
DDE	0.00 mg/L		0.01 ug/L	72-55-9
DIAZINON	0.02 mg/L		0.01 ug/L	333-41-5
DISULFOTON	0.00 mg/L		0.01 ug/L	298-04-4
DIURON	0.05 mg/L		0.05 ug/L	330-54-1
EPTC	0.61 mg/L		0.01 ug/L	759-94-4
FONOFOS			0.01 ug/L	944-22-9
LINURON			0.01 ug/L	330-55-2
MOLINATE	0.05 mg/L		0.01 ug/L	2212-67-1
NITROBENZENE	0.01 mg/L		0.10 ug/L	98-95-3
ORGANOTINS				
PERCHLORATE				14797-73-0

INORGANICS

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLORIDE		\$290.113	125.00 mg/L	16887-00-6
CHROMIUM	0.10 mg/L	\$290.103(1)	50.00 ug/L	11104-59-9
COPPER	1.30 mg/L	\$290.120	65.00 ug/L	17493-86-6
CYANIDE	0.20 mg/L	\$290.103(1)	0.01 mg/L	57-12-5
BERYLLIUM	0.00 mg/L	\$290.103(1)	2.00 ug/L	14701-08-7
BROMIDE				
CADMIUM	0.01 mg/L	\$290.103(1)	2.50 ug/L	22537-48-0
ALUMINUM	24.44 mg/L	\$290.113	0.10 ug/L	14903-36-7
ANTIMONY	0.01 mg/L	\$290.103(1)	3.00 ug/L	64924-52-3
ARSENIC	0.05 mg/L	\$290.103(1)	10.00 ug/L	15584-04-0
ASBESTOS	7.00 mg/L		-9,999.00 ug/L	1332-21-4
BARIUM	2.00 mg/L	\$290.103(1)	1,000.00 ug/L	16541-35-8
SELENIUM	0.05 mg/L	\$290.103(1)	25.00 ug/L	7782-49-2
SILVER	0.12 mg/L	\$290.113	25.00 ug/L	14701-21-4
SULFATE	500.00 mg/L	\$290.113	125.00 mg/L	14808-79-8
TDS		\$290.113	250.00 mg/L	
THALLIUM	0.00 mg/L	\$290.103(1)	1.00 ug/L	7440-28-0
ZINC	7.33 mg/L	\$290.113	2.50 ug/L	15176-26-8
FLUORIDE	4.00 mg/L	\$290.103(1)	2.00 mg/L	16984-48-8
HYDROGEN SULFIDE		\$290.113	0.00 mg/L	15035-72-0
IRON		\$290.113	150.00 ug/L	15438-31-0
LEAD	0.02 mg/L	\$290.120	0.00 ug/L	14701-27-0
MANGANESE	1.15 mg/L	\$290.113	25.00 ug/L	14333-14-3
MERCURY	0.00 mg/L	\$290.103(1)	1.00 ug/L	14302-87-5
NICKEL	0.49 mg/L	\$290.103(1)	50.00 ug/L	14701-22-5
NITRATE	10.00 mg/L	\$290.103(1)	3.00 mg/L	14797-55-8
NITRATE+NITRITE	10.00 mg/L	\$290.103(1)	3.00 mg/L	none
NITRITE	1.00 mg/L	\$290.103(1)	0.50 mg/L	14797-65-0

INORGANICS MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CARBONATE			1.00 mg/L	3812-32-6
BICARBONATE			1.00 mg/L	71-52-3
ALKALINITY			1.00 mg/L	
SPECIFIC CONDUCTANCE			1.00 uS/cm	
MAGNESIUM			0.01 mg/L	14581-92-1

INORGANICS UNREGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CALCIUM			0.02 mg/L	14102-48-8
SODIUM			0.20 mg/L	17341-25-2

PHYSICAL

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
HARDNESS			1.00 mg/L	

PHYSICAL PARAMETER

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
pH		\$290.113	0.10 pH	

RADIOCHEM

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
RADIUM-226	5.00 mg/L	\$290.110	1.00 pCi/L	13982-63-3
RADIUM-228	5.00 mg/L	\$290.110	0.50 pCi/L	15262-20-1
STRONTIUM-90		\$290.110	0.50 pCi/L	10098-97-2
TRITIUM		\$290.110	1.00 pCi/L	15086-10-9
GROSS ALPHA	15.00 mg/L	\$290.110	3.00 pCi/L	
GROSS BETA	4.00 mg/L	\$290.110	3.00 pCi/L	

RADIOCHEM UNREGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
RADON	300.00 mg/L		0.50 pCi/L	10043-92-2
STRONTIUM-89			0.50 pCi/L	14701-18-9
URANIUM	0.02 mg/L		1.00 ug/L	none

SOC MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHRYSENE	0.13 mg/L		0.10 ug/L	218-01-9
BENZO[B]FLUORANTHENE	0.00 mg/L		10.00 ug/L	205-99-2
BENZO[G,H,I]PERYLENE	0.73 mg/L		10.00 ug/L	191-24-2
BENZO[K]FLUORANTHENE	0.01 ug/L		10.00 ug/L	207-08-9
BROMACIL			0.05 ug/L	314-40-9
BUTACHLOR			0.05 ug/L	23184-66-9
BUTYL BENZYL PHTHALATE	4.89 mg/L		5.00 ug/L	85-68-7
CARBARYL	2.44 mg/L		0.01 ug/L	63-25-2
2,4,5-T	0.24 mg/L		0.05 ug/L	93-76-5
3-HYDROXYCARBOFURAN			0.05 ug/L	16655-82-6
ACENAPHTHENE	1.47 mg/L		5.00 ug/L	83-32-9
ACENAPHTHYLENE	1.47 mg/L		5.00 ug/L	208-96-8
ALDRIN	0.00 mg/L		0.10 ug/L	309-00-2
ANTHRACENE	7.33 mg/L		5.00 ug/L	120-12-7
BENTAZON			0.05 ug/L	25057-89-0
BENZO[A]ANTHRACENE	0.00 mg/L		10.00 ug/L	56-55-3
PHENANTHRENE			5.00 ug/L	85-01-8
PROMETON			0.01 ug/L	1610-18-0
PROPACHLOR			0.01 ug/L	1918-16-7
PYRENE	0.73 mg/L		0.10 ug/L	129-00-0
TRIFLURALIN	0.12 mg/L		0.01 ug/L	1582-09-8
DIBENZ[A,H]ANTHRACENE	0.00 mg/L		10.00 ug/L	53-70-3
DICAMBA	0.73 mg/L		0.05 ug/L	1918-00-9
DIELDRIN	0.00 mg/L		0.01 ug/L	60-57-1
DIETHYL PHTHALATE	19.55 mg/L		5.00 ug/L	84-66-2
DIMETHYL PHTHALATE	19.55 mg/L		5.00 ug/L	131-11-3
DI-N-BUTYL PHTHALATE	2.44 mg/L		5.00 ug/L	84-74-2
FLUORENE	0.98 mg/L		0.10 ug/L	86-73-7

INDENO[1,2,3-CD]PYRENE		10.00 ug/L	193-39-5
LAMBAST		0.05 ug/L	845-52-3
METHIOCARB		0.05 ug/L	2032-65-7
METHOMYL	0.61 mg/L	0.05 ug/L	16752-77-5
METOLACHLOR	3.67 mg/L	0.01 ug/L	51218-45-2
METRIBUZIN		0.01 ug/L	21087-64-9

SOC REGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLORDANE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	57-74-9
CHLORDANE (ALPHA-CHLORDANE)	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	5103-71-9
CHLORDANE (GAMMA-CHLORDANE)	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	12789-03-6
CHLORDANE (TRANS-NONACHLOR)	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	39765-80-5
DALAPON	0.20 mg/L	\$290.103(3)(A)	0.05 mg/L	75-99-0
CARBOFURAN	0.04 mg/L	\$290.103(3)(A)	0.01 ug/L	1563-66-2
2,3,7,8-TCDD	0.00 mg/L	\$290.103(3)(A)	0.10 mg/L	1746-01-6
2,4,5-TP	0.05 mg/L	\$290.103(3)(A)	0.05 ug/L	93-72-1
2,4-D	0.07 mg/L	\$290.103(3)(A)	0.15 ug/L	94-75-7
ALACHLOR	0.00 mg/L	\$290.103(3)(A)	0.01 ug/L	15972-60-8
ALDICARB	0.01 mg/L	\$290.103(3)(A)	0.55 ug/L	116-06-3
ALDICARB SULFONE	0.01 mg/L	\$290.103(3)(A)	0.10 ug/L	1646-88-4
ALDICARB SULFOXIDE	0.01 mg/L	\$290.103(3)(A)	0.05 ug/L	1646-87-3
ATRAZINE	0.00 mg/L	\$290.103(3)(A)	0.01 ug/L	1912-24-9
BENZO(A)PYRENE	0.00 mg/L	\$290.103(3)(A)	10.00 ug/L	50-32-8
PICLORAM	0.50 mg/L	\$290.103(3)(A)	0.05 ug/L	1918-02-1
SIMAZINE	0.00 mg/L		0.01 ug/L	122-34-9
TOXAPHENE	0.00 mg/L	\$290.103(3)(A)	2.00 ug/L	8001-35-2
DI-(2-ETHYLHEXYL)ADIPATE	0.40 mg/L	\$290.103(3)(A)	5.00 ug/L	103-23-1
DI-(2-ETHYLHEXYL)PHthalATE	0.01 mg/L	\$290.103(3)(A)	5.00 ug/L	117-81-7
DIBROMOCHLOROPROPANE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	67708-83-2
DINOSEB	0.01 mg/L	\$290.103(3)(A)	0.05 ug/L	88-85-7
DIQUAT	0.02 mg/L	\$290.103(3)(A)	0.05 mg/L	2764-72-9
ENDOTHALL	0.10 mg/L	\$290.103(3)(A)	0.05 ug/L	145-73-3
ENDRIN	0.00 mg/L	\$290.103(3)(A)	0.05 ug/L	72-20-8
ETHYLENE DIBROMIDE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	106-93-4
GLYPHOSATE	0.70 mg/L	\$290.103(3)(A)	0.05 ug/L	1071-83-6
HEPTACHLOR	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	76-44-8
HEPTACHLOR EPOXIDE	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	1024-57-3
HEXACHLOROBENZENE	0.00 mg/L	\$290.103(3)(A)	5.00 ug/L	118-74-1
HEXACHLOROCYCLOPENTADIENE	0.05 mg/L	\$290.103(3)(A)	5.00 ug/L	77-47-4
LINDANE	0.00 mg/L	\$290.103(3)(A)	0.01 ug/L	58-89-9
METHOXYCHLOR	0.04 mg/L	\$290.103(3)(A)	0.05 ug/L	72-43-5
OXAMYL	0.20 mg/L	\$290.103(3)(A)	0.05 ug/L	23135-22-0
PCBs	0.00 mg/L	\$290.103(3)(A)	0.10 ug/L	53469-21-9
PENTACHLOROPHENOL	0.00 mg/L	\$290.103(3)(A)	30.00 ug/L	87-86-5

THM

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROFORM	0.10 mg/L	\$290.116	0.10 ug/L	67-66-3
BROMOCHLOROMETHANE	0.98 mg/L		0.10 ug/L	74-97-5
BROMODICHLOROMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	75-27-4
BROMOFORM	0.10 mg/L	\$290.116	0.10 ug/L	75-25-2
BROMOMETHANE	0.03 mg/L		0.10 ug/L	74-83-9
DIBROMOCHLOROMETHANE	0.10 mg/L	\$290.116	0.10 ug/L	124-48-1

VOC - OTHER COMPOUNDS

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CARBON DISULFIDE	2.44 mg/L		0.10 ug/L	75-15-0
2-HEXANONE	1.47 mg/L		0.10 ug/L	591-78-6
4-METHYL-2-PENTANONE (MIBK)	1.96 mg/L		0.10 ug/L	108-10-1
ACETONE	2.44 mg/L		0.10 ug/L	67-64-1
ACRYLONITRILE	0.00 mg/L		0.10 ug/L	107-13-1
TETRAHYDROFURAN	0.12 mg/L		0.10 ug/L	109-99-9
VINYL ACETATE	24.44 mg/L		0.10 ug/L	108-05-4
ETHYL METHACRYLATE	2.20 mg/L		0.10 ug/L	97-63-2
METHYL IODIDE (IodomETHANE)	0.03 mg/L		0.10 ug/L	74-88-4
METHYL ETHYL KETONE	14.67 mg/L		0.10 ug/L	78-93-3
METHYL METHACRYLATE	34.22 mg/L		0.10 ug/L	80-62-6

METHYL-T-BUTYL ETHER

0.24 mg/L

0.10 ug/L

1634-04-4

VOC MONITORED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROETHANE	9.78 mg/L		0.10 ug/L	75-00-3
CHLOROMETHANE	0.07 mg/L		0.10 ug/L	74-87-3
CIS-1,3-DICHLOROPROPENE	0.00 mg/L		0.10 ug/L	10061-01-5
BROMOBENZENE	0.49 mg/L		0.10 ug/L	108-86-1
2-CHLOROTOLUENE	0.49 mg/L		0.10 ug/L	95-49-8
4-CHLOROTOLUENE	0.49 mg/L		0.10 ug/L	106-43-4
4-ISOPROPYLTOLUENE	2.44 mg/L		0.10 ug/L	99-87-6
1,1,1,2-TETRACHLOROETHANE	0.04 mg/L		0.10 ug/L	630-20-6
1,1,2,2-TETRACHLOROETHANE	0.17 mg/L		0.10 ug/L	79-34-5
1,1-DICHLOROETHANE	2.44 mg/L		0.10 ug/L	75-34-3
1,1-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	563-58-6
1,2,3-TRICHLOROBENZENE	0.07 mg/L		0.10 ug/L	87-61-6
1,2,3-TRICHLOROPROPANE	0.00 mg/L		0.10 ug/L	96-18-4
1,2,4-TRIMETHYLBENZENE	1.22 mg/L		0.10 ug/L	95-63-6
1,3,5-TRIMETHYLBENZENE	1.22 mg/L		0.10 ug/L	108-67-8
1,3-DICHLOROBENZENE	0.73 mg/L		0.10 ug/L	541-73-1
1,3-DICHLOROPROPANE	0.01 mg/L		0.10 ug/L	142-28-9
2,2-DICHLOROPROPANE			0.10 ug/L	594-20-7
S-BUTYLBENZENE	0.98 mg/L		0.10 ug/L	135-98-8
T-BUTYLBENZENE	0.98 mg/L		0.10 ug/L	98-06-6
TRANS-1,3-DICHLOROPROPENE	0.01 mg/L		0.10 ug/L	10061-02-6
TRICHLOROFLUOROMETHANE	7.33 mg/L		0.10 ug/L	75-69-4
DIBROMOMETHANE	0.12 mg/L		0.10 ug/L	74-95-3
DICHLORODIFLUOROMETHANE	4.89 mg/L		0.10 ug/L	75-71-8
HEXACHLOROBUTADIENE	0.00 µg/L		0.10 ug/L	87-68-3
ISOPROPYLBENZENE	2.44 mg/L		0.10 ug/L	98-82-8
M + P XYLENE			0.10 ug/L	106-42-3
NAPHTHALENE	0.49 mg/L		0.10 ug/L	91-20-3
N-BUTYLBENZENE	0.98 mg/L		0.10 ug/L	104-51-8
N-PROPYLBENZENE	0.98 mg/L		0.10 ug/L	103-65-1

VOC REGULATED

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CHLOROBENZENE (MONOCHLOROBENZENE)	0.10 mg/L		0.10 ug/L	108-90-7
CIS-1,2-DICHLOROETHYLENE	0.07 mg/L	\$290.103(3)(B)	0.10 ug/L	156-59-2
CARBON TETRACHLORIDE	0.00 mg/L	\$290.103(3)(B)	0.10 ug/L	56-23-5
1,1,1-TRICHLOROETHANE	0.20 mg/L	\$290.103(3)(B)	0.10 ug/L	71-55-6
1,1,2-TRICHLOROETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	79-00-5
1,1-DICHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	75-35-4
1,2,4-TRICHLOROBENZENE	0.07 mg/L	\$290.103(3)(B)	0.10 ug/L	120-82-1
1,2-DICHLOROETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	107-06-2
1,2-DICHLOROPROPANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	78-87-5
BENZENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	71-43-2
P-XYLENE		\$290.103(3)(B)	0.10 ug/L	106-42-3
STYRENE	0.10 mg/L	\$290.103(3)(B)	0.10 ug/L	100-42-5
TETRACHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	127-18-4
TOLUENE	1.00 mg/L	\$290.103(3)(B)	0.10 ug/L	108-88-3
TRANS-1,2-DICHLOROETHYLENE	0.10 mg/L	\$290.103(3)(B)	0.10 ug/L	156-60-5
TRICHLOROETHYLENE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	79-01-6
VINYL CHLORIDE	0.00 mg/L	\$290.103(3)(B)	0.10 ug/L	75-01-4
XYLENES (TOTAL)	10.00 mg/L	\$290.103(3)(B)	0.10 ug/L	none
DICHLOROMETHANE	0.01 mg/L	\$290.103(3)(B)	0.10 ug/L	75-09-2
ETHYLBENZENE	0.70 mg/L	\$290.103(3)(B)	0.10 ug/L	100-41-4
MONOCHLOROBENZENE (CHLOROBENZENE)		\$290.103(3)(B)	0.10 ug/L	108-90-7
M-XYLENE	10.00 mg/L		0.10 mg/L	108-38-3
ORTHO-1,2-DICHLOROBENZENE	0.60 mg/L	\$290.103(3)(B)	0.10 ug/L	95-50-1
O-XYLENE		\$290.103(3)(B)	0.10 mg/L	95-47-6
PARA-1,4-DICHLOROBENZENE	0.08 mg/L	\$290.103(3)(B)	0.10 ug/L	106-46-7

Other

Contaminant Name	Drinking Water Standard	PWS Rule	TCEQ Threshold	CAS Number
CRYPTOSPORIDIUM PARVUM				
AROCLOR (PCB)			0.05 ug/L	53469-21-9
TOTAL ALPHA EMITTING RADIUM	5.00 mg/L	\$290.110		

TOTAL COLIFORM			
TOTAL TRIHALOMETHANE	0.10 mg/L	\$290.116	0.10 ug/L
TRIAZINES			
ESCHERICHIA COLI			
FECAL VIRUSES			
GIARDIA LAMBLIA			
P-ALKALINITY			

Map Legend

Water System Sources

Source Type

Source Type

 Surface Water

 Ground Water

Capture Zones

Travel Time

 2 Years

 5 Years

 10 Years

 20 Years

 50 Years

 100 Years

 Other

Truncated Watersheds



Potential Sources of Contamination

Type Description

 ANIMAL FEEDING OPERATION

 BUSINESS

 CEMETERY

 CHEMICAL PIPELINE

 CHEMICAL STORAGE

 CLASS I INJECTION WELL

 CLASS II INJECTION WELL

 CLASS III INJECTION WELL

 CLASS IV INJECTION WELL

 CLASS V INJECTION WELL

 GUN RANGE

 NATURAL RESOURCE PRODUCTION

 TRANSPORTATION

 WASTE

 WASTEWATER

API



